


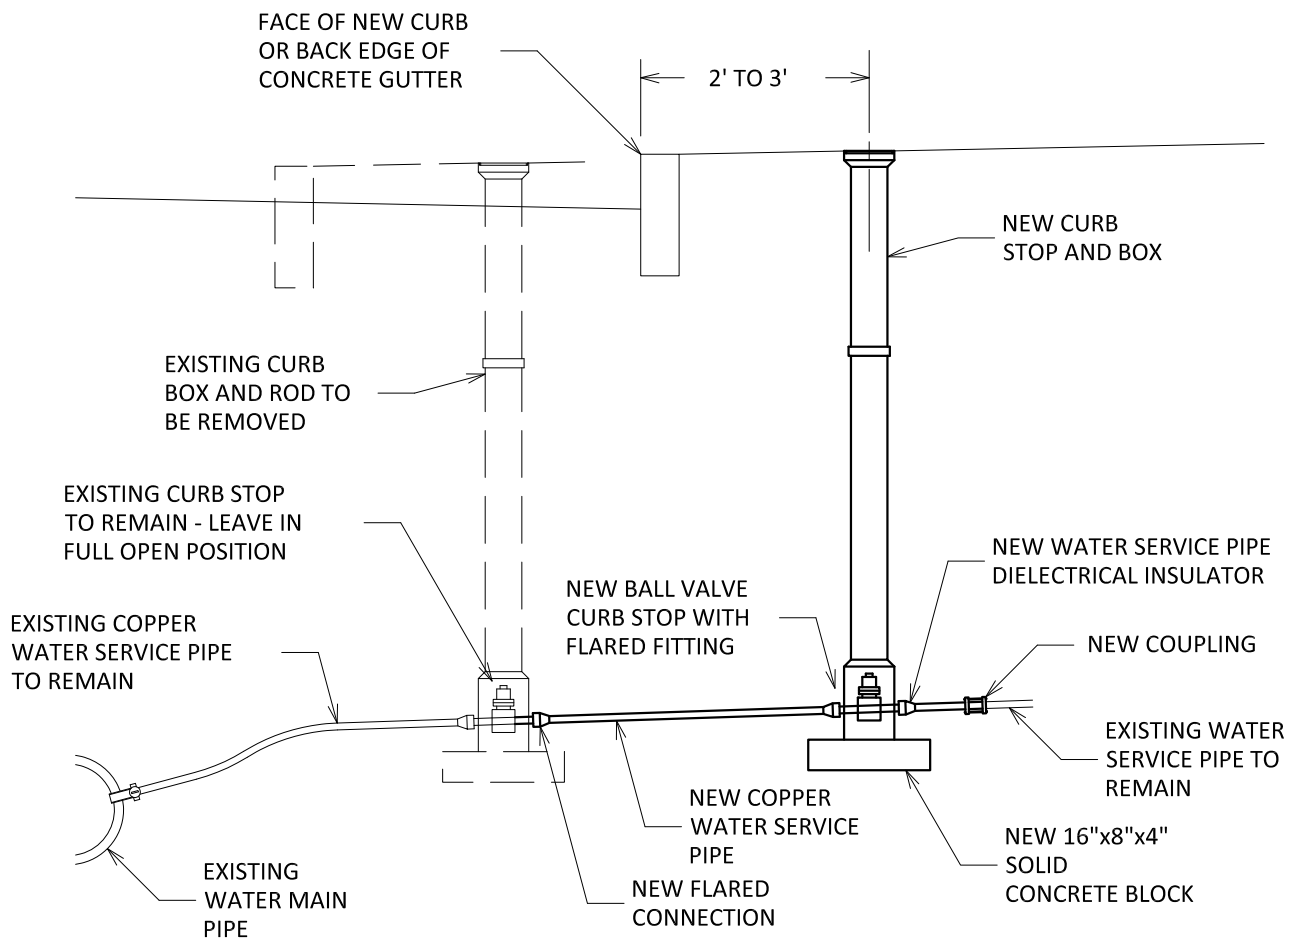

NOTES:

1. FOR COPPER WATER SERVICE PIPE 1½ INCHES AND LARGER, ADD CURB BOX ARCH TO CURB BOX.
2. MAGNESIUM ANODE MUST BE INSTALLED FOR COPPER WATER SERVICE PIPE, SEE DETAIL S966-3.
3. WARNING TAPE MUST BE INSTALLED WITH ALL OPEN CUT TRENCHED WATER SERVICE PIPE INSTALLATIONS.
4. REFER TO WATER BUREAU'S APPROVED PRODUCT LIST FOR LIST OF APPROVED WATER SERVICE PRODUCTS.

CITY OF ROCHESTER		
EXISTING COPPER WATER SERVICE PIPE EXTENSION 2 INCH AND SMALLER		
ISSUED	9-2-91	STD. DWG.
REVISED	6-1-09	NO. R913-2