


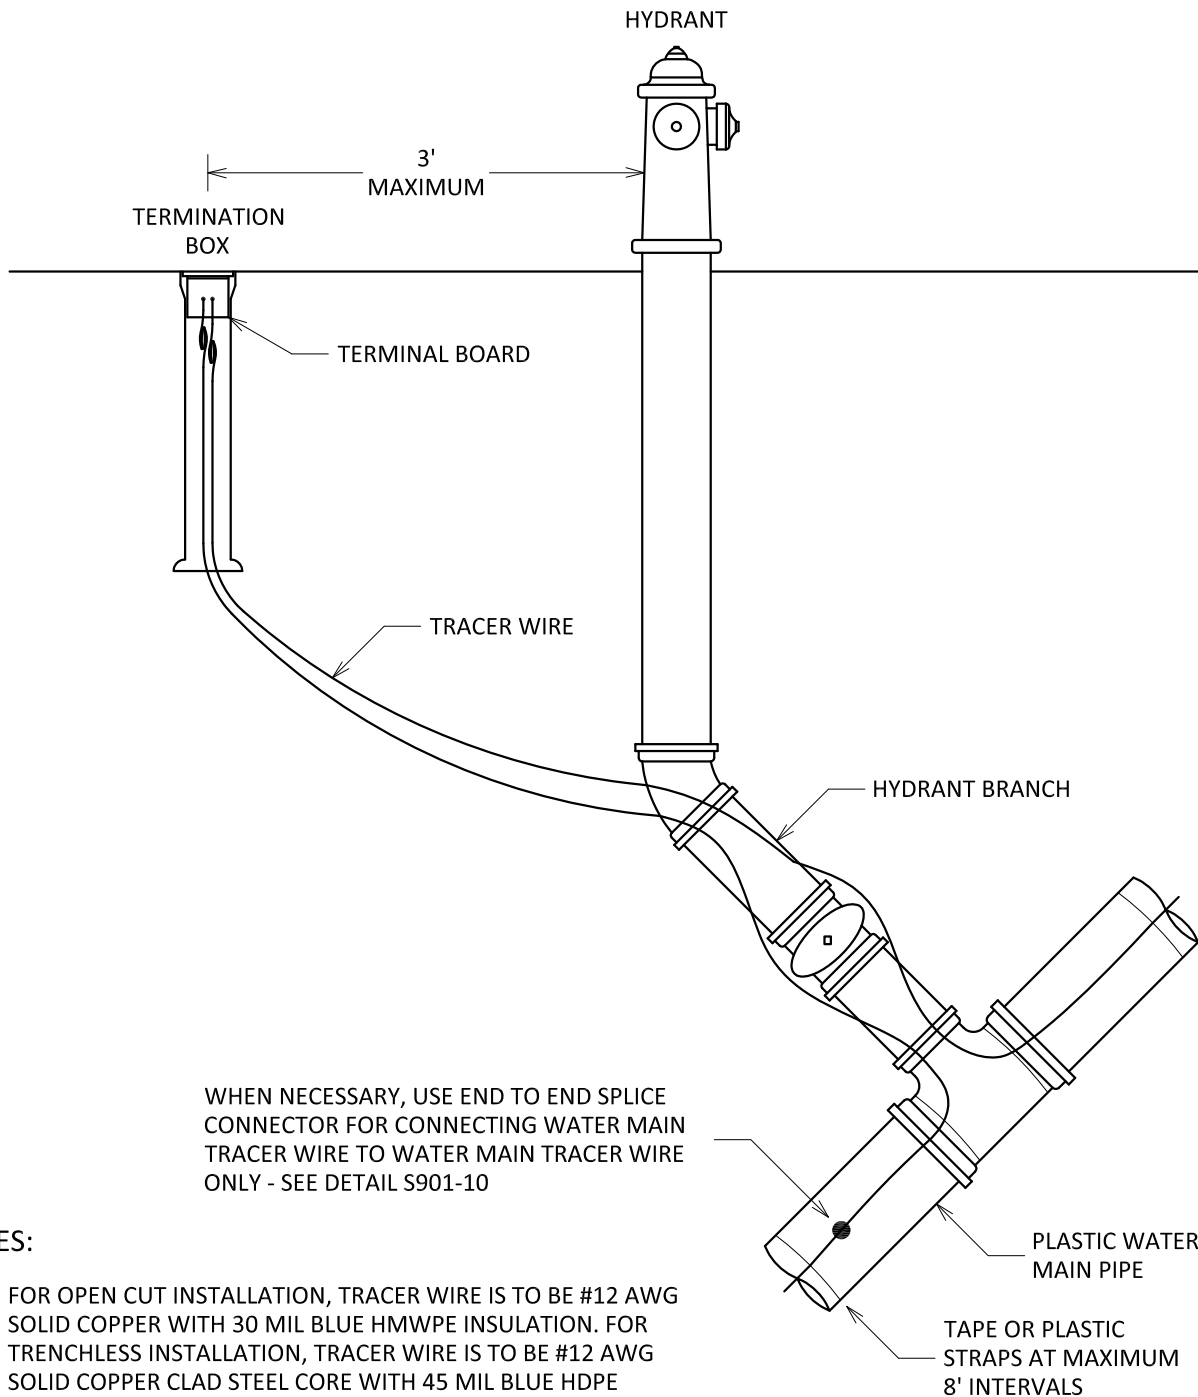

NOTES:

1. FOR OPEN CUT INSTALLATION, TRACER WIRE IS TO BE #12 AWG SOLID COPPER WITH 30 MIL BLUE HMWPE INSULATION. FOR TRENCHLESS INSTALLATION, TRACER WIRE IS TO BE #12 AWG SOLID COPPER CLAD STEEL CORE WITH 45 MIL BLUE HDPE INSULATION.
2. FOR PLASTIC WATER MAIN PIPE, TRACER WIRE IS TO RUN ALONG TOP OF AND BE SECURED TO WATER MAIN PIPE WITH PLASTIC STRAPS OR TAPE PLACED AT MAXIMUM 8 FEET INTERVALS. AT WATER VALVE, TRACER WIRE IS TO RUN ALONG SIDE OF PLASTIC WATER MAIN PIPE.
3. TRACER WIRE IS TO BE CONNECTED TO TERMINATION BOX INSTALLED ADJACENT TO HYDRANT. EXTEND TRACER WIRE UP INSIDE OF TERMINATION BOX LEAVING MINIMUM OF 3 FEET OF TRACER WIRE COILED UP INSIDE TOP OF TERMINATION BOX. CONNECT END OF TRACER WIRE TO TERMINAL BOARD.

CITY OF ROCHESTER		
PLASTIC WATER MAIN TRACER WIRE INSTALLATION		
ISSUED	1-13-06	NON-STANDARD DWG.NO.S901-8
REVISED	6-1-09	