



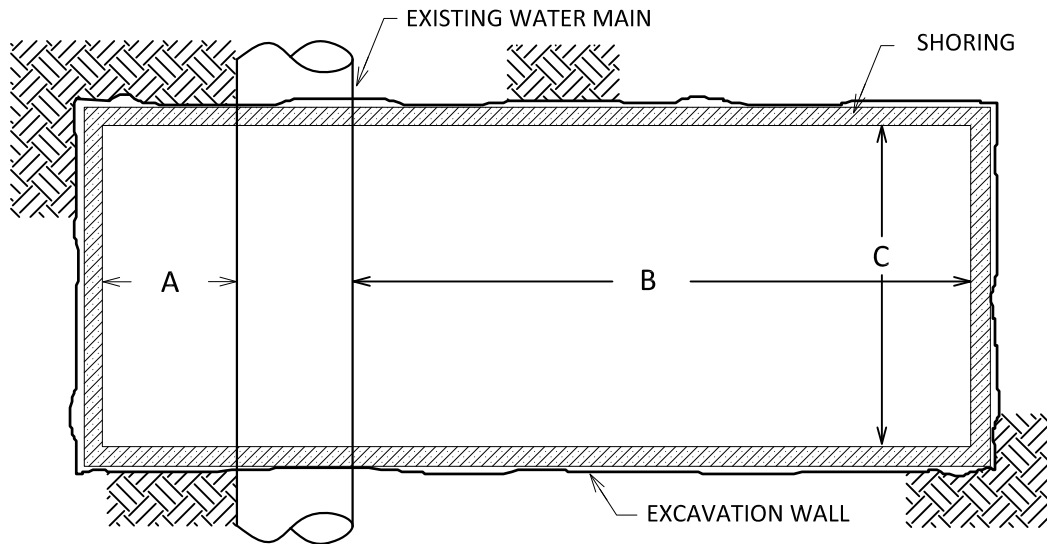

PLAN

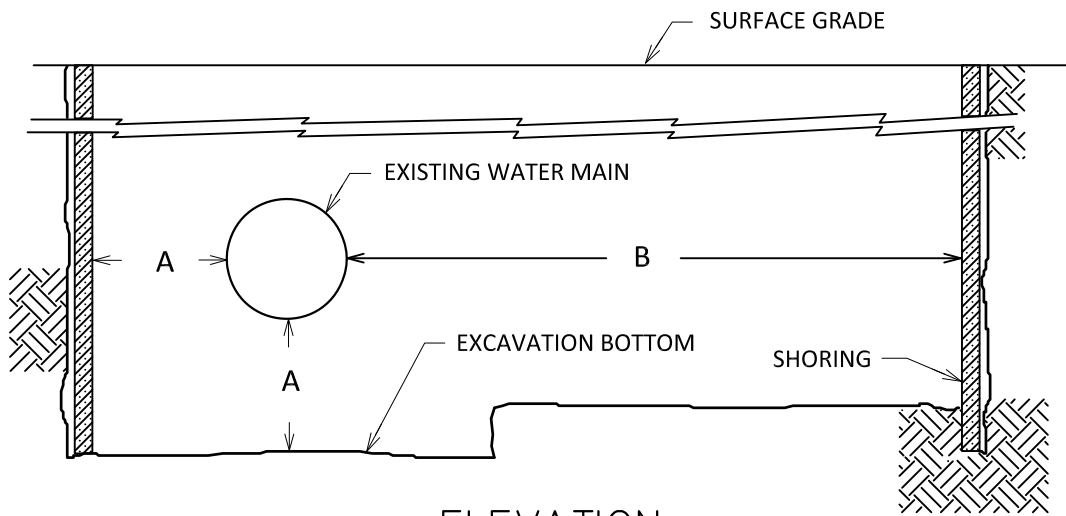

ELEVATION

NOTES:

1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL EXCAVATIONS ARE ADEQUATELY PROTECTED IN ACCORDANCE WITH OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA) REGULATIONS.
2. SHORING MUST BE FURNISHED BY THE CONTRACTOR IN ACCORDANCE WITH OSHA REGULATIONS, AND ADEQUATE CLEARANCES PROVIDED, WHEREVER WATER BUREAU PERSONNEL MUST ENTER AN EXCAVATION. EXCEPTIONS TO THIS POLICY CAN ONLY BE MADE BY THE DIRECTOR OF WATER OR HIS REPRESENTATIVE.
3. THE CONTRACTOR SHALL MAKE AND SHORE THE EXCAVATION, CLEAN THE AREA OF THE WATER MAIN FOR THE TAP, ATTACH THE TAPPING SLEEVE AND VALVE TO THE MAIN FOR SERVICES 4-INCH DIAMETER AND LARGER OR ATTACH THE TAPPING SADDLE (WHERE REQUIRED) TO THE MAIN FOR SERVICES 2-INCH DIAMETER AND SMALLER AND INSURE THAT THE WORK AREA IS READY FOR INSPECTION BY BUREAU PERSONNEL PRIOR TO MAKING THE TAP.

MINIMUM CLEARANCE DIMENSIONS

EXCAVATION FOR	A	B	C
SMALL SERVICE TAP (2-INCH AND SMALLER)	0'-6"	5'-0"	4'-0"
LARGE SERVICE TAP (4-INCH AND LARGER)	1'-0"	7'-0"	4'-0"

CITY OF ROCHESTER

**WATER SERVICE TAP
EXCAVATION**

ISSUED	4-29-11	NON-STANDARD DWG.NO.S900-12
REVISED		