


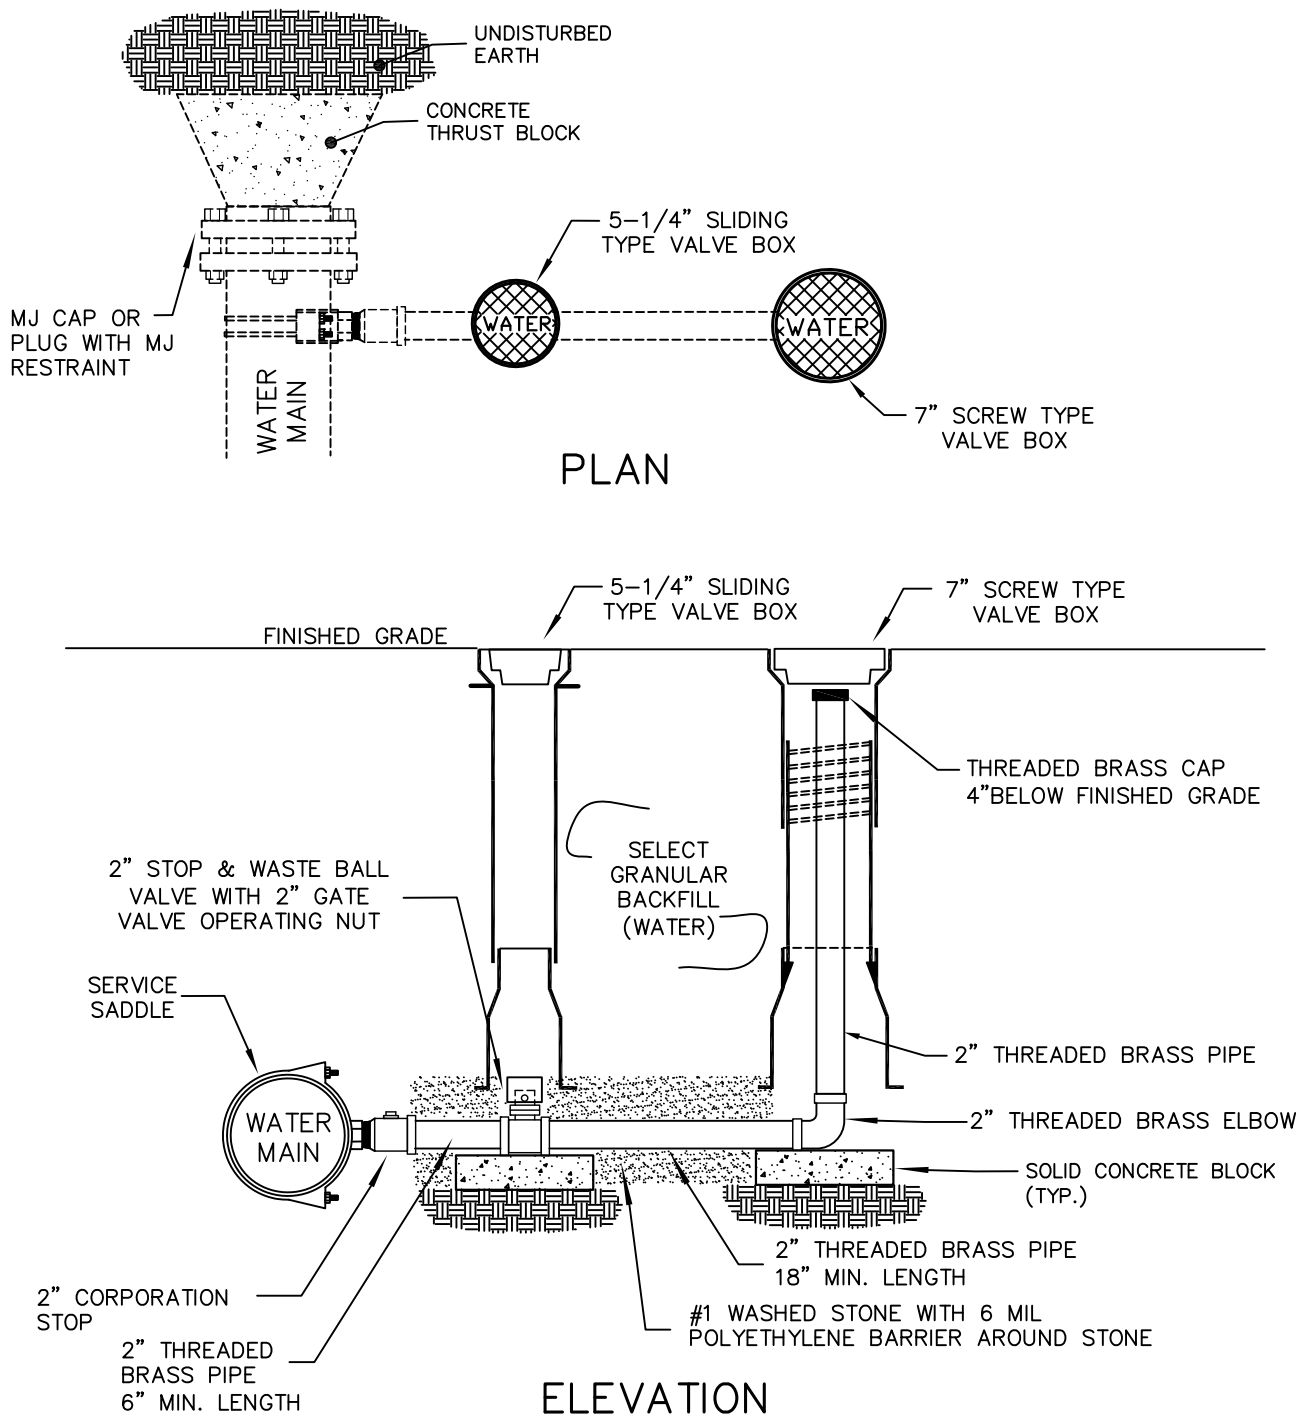

NOTES:

1. BLOW-OFF SHALL BE LOCATED AS CLOSE AS POSSIBLE TO THE END OF WATER MAIN.
2. ATTACH ONE 5 POUND ANODE TO 2 INCH BRASS PIPE NEAR BASE OF ELBOW USING BRONZE GROUND CLAMP.

CITY OF ROCHESTER

PERMANENT BLOW-OFF ASSEMBLY

ISSUED	2-25-14	STD. DWG.
REVISED		NO. S922-1