


LIGHT DUTY

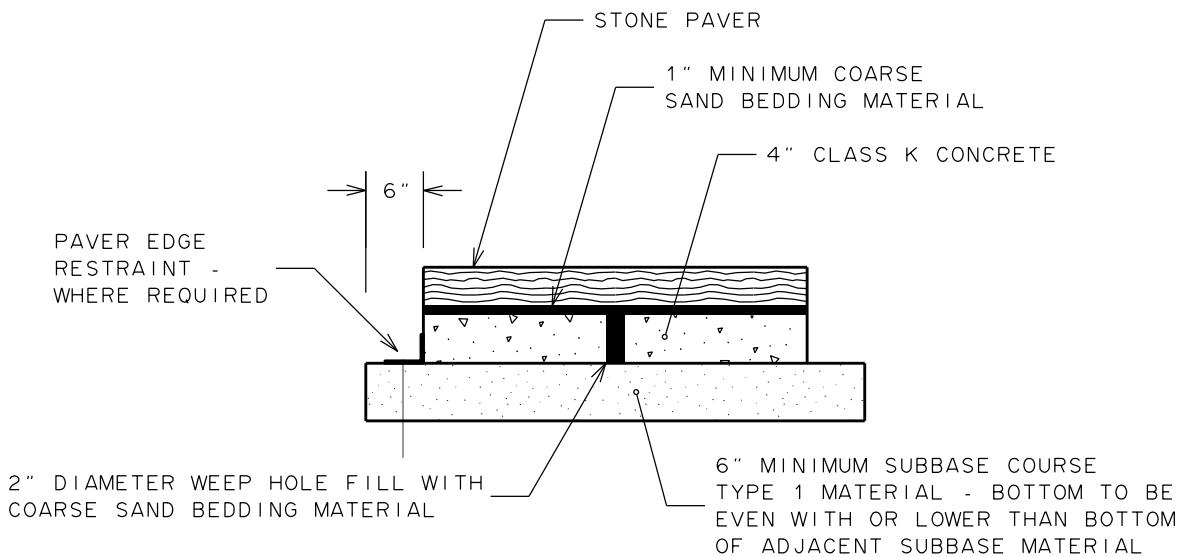

MEDIUM DUTY

NOTES:

1. MAXIMUM CROSS-SLOPE OF STONE PAVER SIDEWALK IS 1:50.
2. PROVIDE 1/2 INCH WIDE EXPANSION JOINT BETWEEN NEW STONE PAVER CONSTRUCTION AND BACK EDGE CURB, CONCRETE GUTTER, OTHER PAVED AREAS, BUILDINGS, WALLS, POLE BASES AND OTHER STRUCTURES/ APPURTENANCES.
3. FOR EXPANSION JOINT USE PREMOULDED EXPANSION JOINT MATERIAL, SEAL TOP WITH CAULKING SEALANT 5/8 INCH DEEP.
4. PROVIDE WEEP HOLE THRU CONCRETE FOUNDATION FOR EVERY 100 SQUARE FEET OF STONE AREA AND AT ALL LOW POINTS.

CITY OF ROCHESTER

STONE PAVER

ISSUED	9-2-91	STANDARD
REVISED	12-1-15	DWG.NO.R608-9