


## LIGHT DUTY

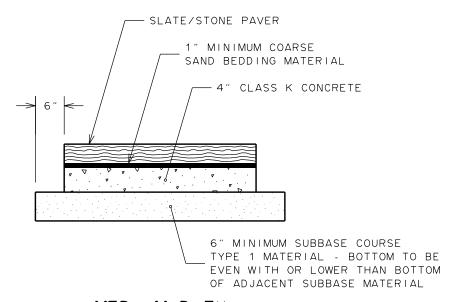

## MEDIUM DUTY

## NOTES:

- 1. MAXIMUM CROSS-SLOPE OF SLATE/STONE PAVER SIDEWALK IS 1:50.
- 2. PROVIDE ½ INCH WIDE EXPANSION JOINT BETWEEN NEW SLATE/STONE PAVER CONSTRUCTION AND BACK EDGE CURB, CONCRETE GUTTER, OTHER PAVED AREAS, BUILDINGS, WALLS, POLE BASES AND OTHER STRUCTURES/ APPURTENANCES.
- 3. FOR EXPANSION JOINT USE  $\frac{1}{2}$  INCH WIDE PREMOULDED EXPANSION JOINT MATERIAL, SEALED WITH  $\frac{1}{2}$  INCH WIDE CAULKING SEALANT  $\frac{1}{8}$  INCH DEEP.

CITY OF ROCHESTER

## SLATE/STONE PAVER

ISSUED		STANDARD
REVISED	5 - 1 - 13	DWG.NO.R608-9