


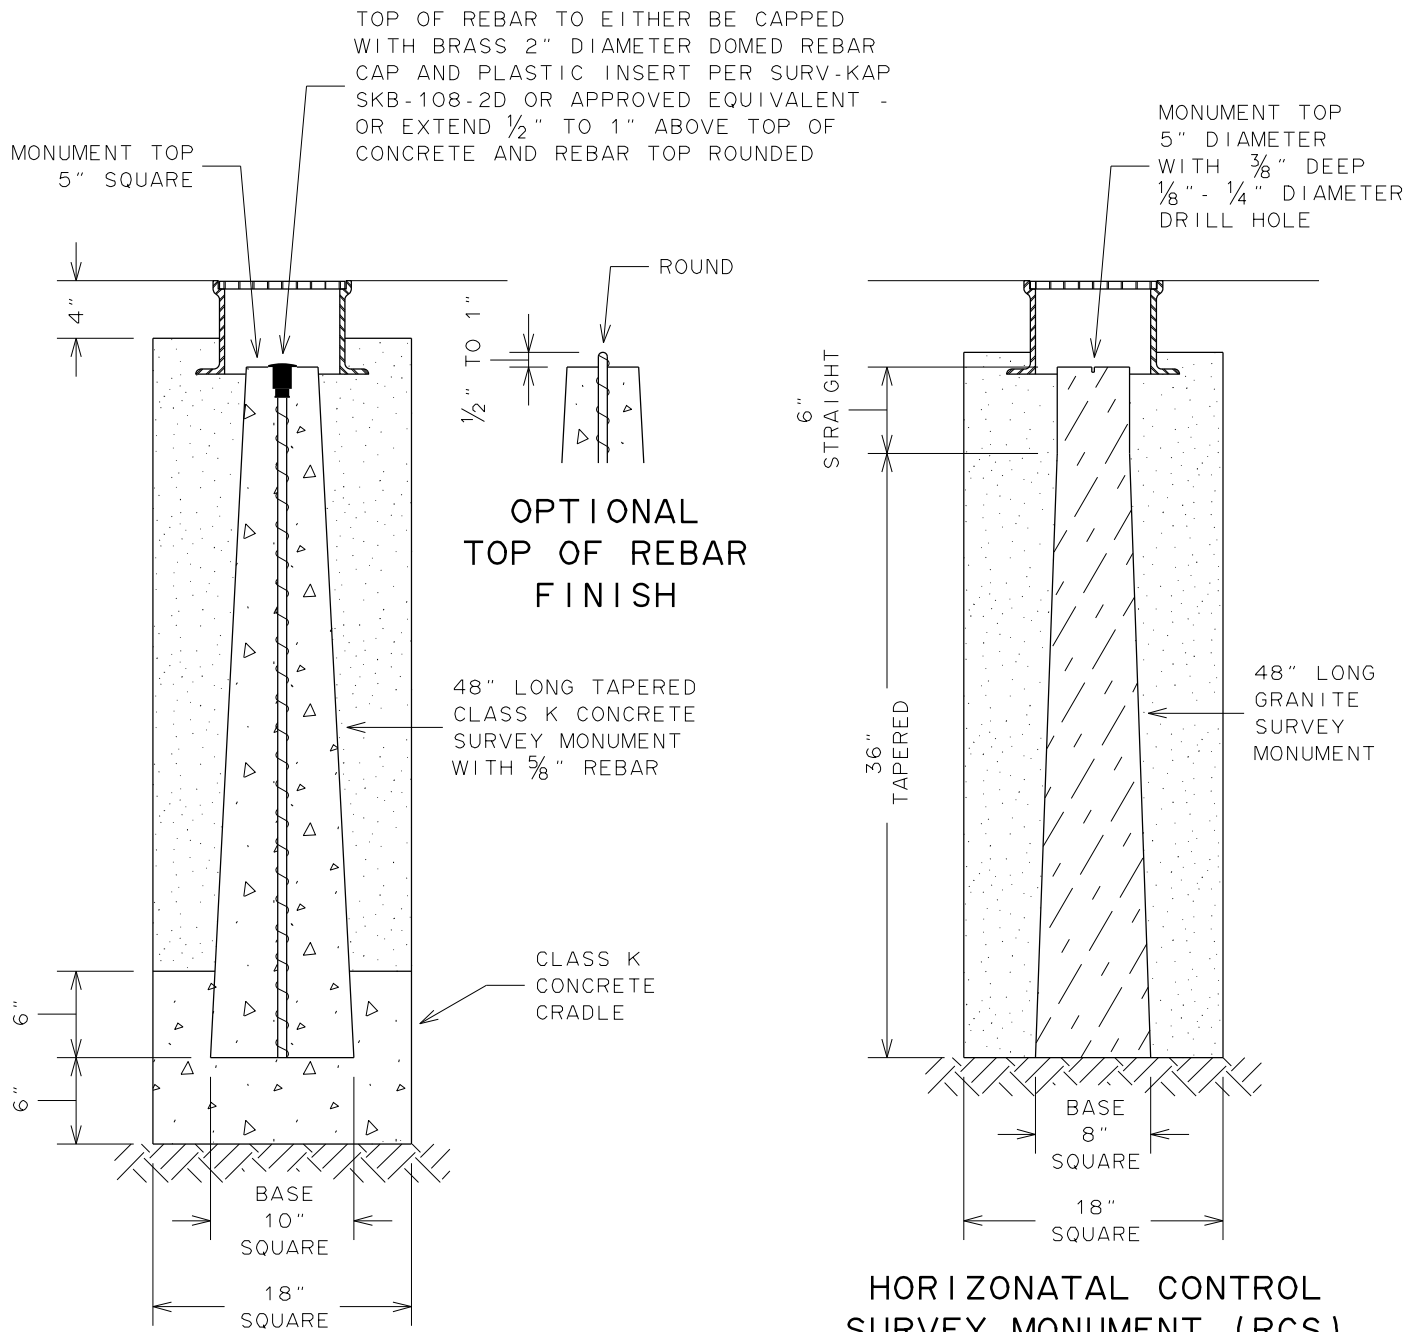

NOTES:

1. SURVEY MONUMENT TO BE SET PLUMB.
2. TOP OF SURVEY MONUMENT TO BE MINIMUM 4 INCHES AND MAXIMUM 6 INCHES BELOW FINISHED GRADE.
3. BACKFILL EXCAVATION WITH SELECT GRANULAR FILL COMPACTED IN 6 INCH LAYERS.
4. FOR SURVEY MONUMENT FRAME AND COVER SEE DETAIL S626-7.

CITY OF ROCHESTER		
SURVEY MONUMENT		
ISSUED	9-2-91	STANDARD DWG.NO.R626-1
REVISED	1-1-17	