


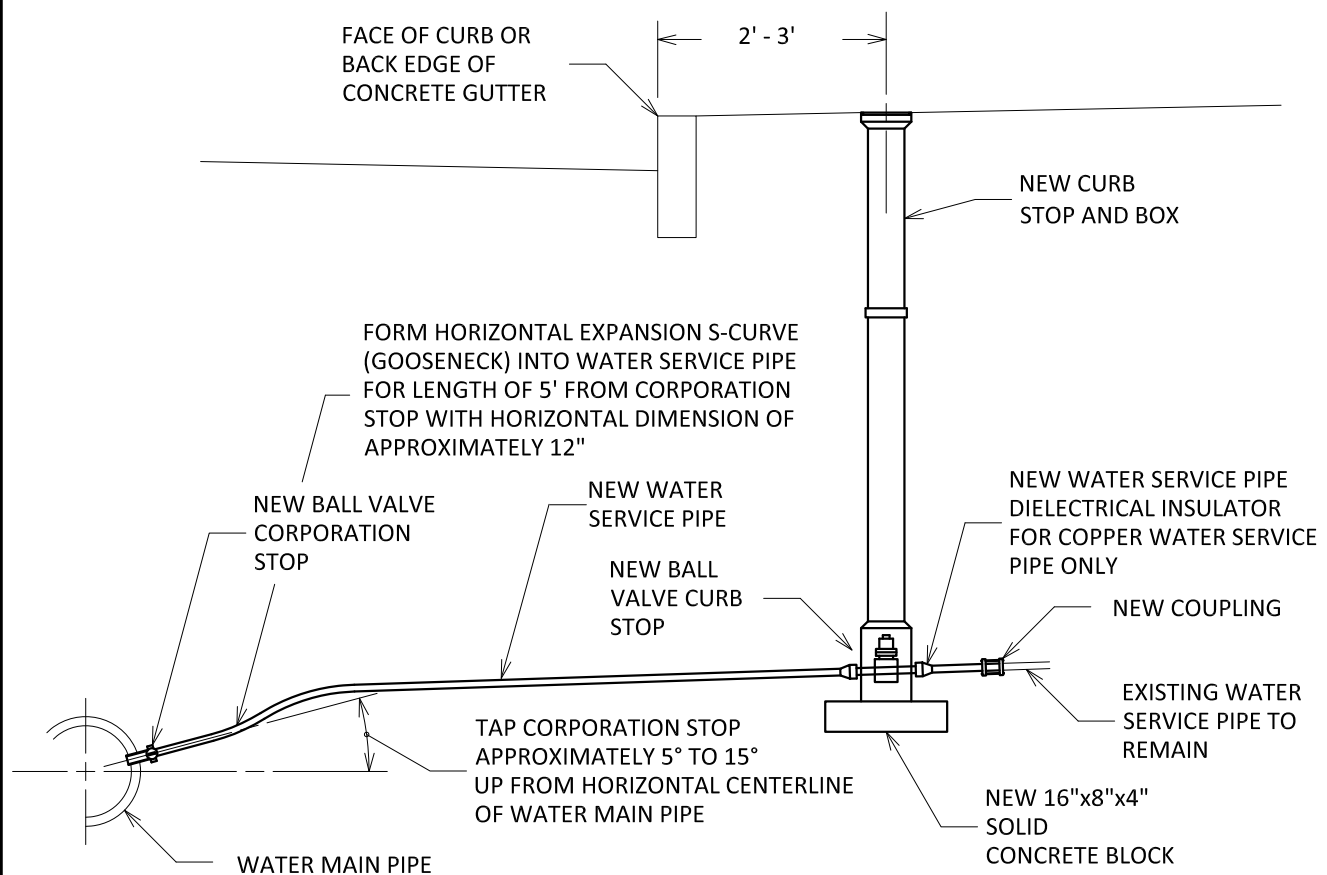

NOTES:

1. WATER SERVICE PIPE IS TO HAVE MINIMUM COVER DEPTH OF 4.50 FEET FROM FINISHED SURFACE.
2. WATER SERVICE TAP IS TO BE MADE ON CUSTOMER SIDE OF WATER MAIN PIPE. FOR PLASTIC WATER MAIN PIPE USE WIDE STRAP BRASS TAPPING SADDLE. FOR CAST/DUCTILE IRON WATER MAIN PIPE USE DOUBLE STRAP BRASS TAPPING SADDLE, SEE TABLE.
3. WATER SERVICE PIPE IS TO RUN PERPENDICULAR TO WATER MAIN PIPE.
4. FOR WATER SERVICE PIPE 1½ INCHES AND LARGER, ADD CURB BOX ARCH TO CURB BOX.
5. TRACER WIRE MUST BE INSTALLED FOR PLASTIC WATER SERVICE PIPE, SEE DETAILS S901-9 AND S901-11.
6. MAGNESIUM ANODE MUST BE INSTALLED FOR COPPER WATER SERVICE PIPE, SEE DETAIL S966-3.
7. WARNING TAPE MUST BE INSTALLED WITH ALL OPEN CUT TRENCHED WATER SERVICE PIPE INSTALLATIONS.
8. REFER TO WATER BUREAU'S APPROVED PRODUCT LIST FOR LIST OF APPROVED WATER SERVICE PRODUCTS.

SERVICE SADDLE REQUIREMENTS FOR TAPS ON CAST/DUCTILE IRON WATER MAIN PIPE	
WATER MAIN PIPE SIZE (INCHES)	MAXIMUM TAP SIZE ALLOWED w/o SERVICE SADDLE (INCHES)
4" - 6"	ALL TAPS REQUIRE SADDLE
8" - 10"	¾"
12"	1"
16" AND LARGER	1½"

CITY OF ROCHESTER

WATER SERVICE PIPE 2 INCH AND SMALLER

ISSUED	9-2-91	STD. DWG. NO. R913-1
REVISED	6-1-09	