




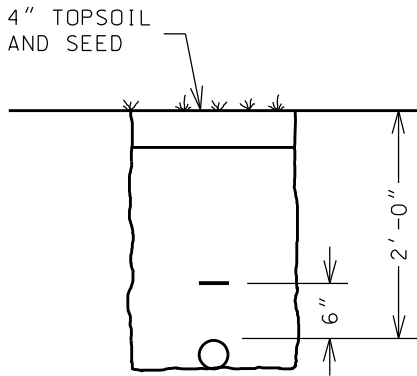


LAWN AREA

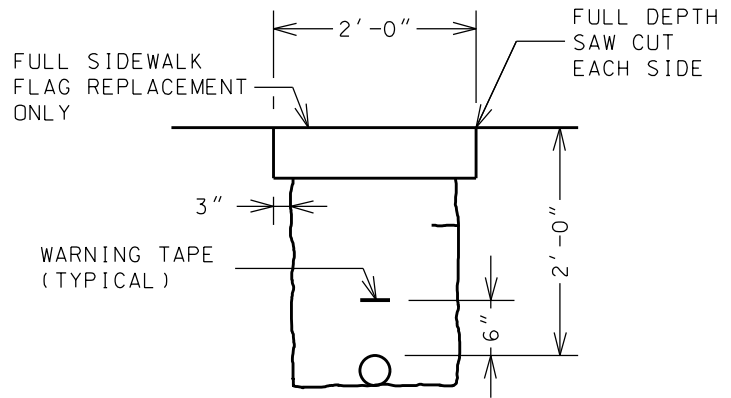

DRIVEWAY OR SIDEWALK CROSSING

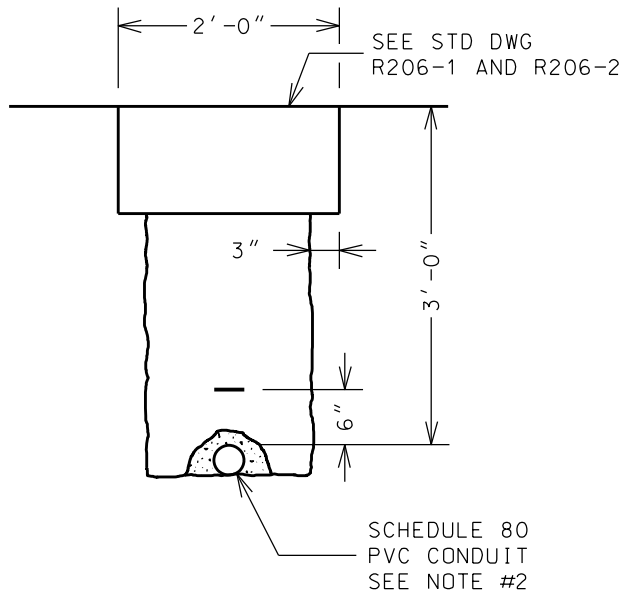

ROADWAY CROSSING

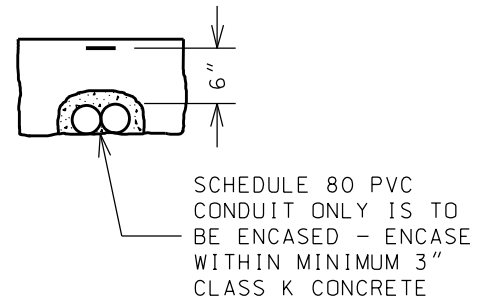

MULTIPLE CONDUITS

NOTES:

1. ALL CONDUIT RUNS ARE TO DRAIN INTO THE PULLBOX.
2. IF REQUIRED BY PROJECT MANAGER, CONDUIT FOR ROADWAY CROSSINGS IS TO BE ENCASED WITHIN CLASS K CONCRETE - FROM PULLBOX TO PULLBOX, OR FROM PULLBOX TO LIGHT POLE.

CITY OF ROCHESTER

**CONDUIT
TRENCH**

ISSUED 9-2-91

REVISED 4-28-06

STD. DWG.
NO. R671-1